

Two-hand control unit

Requirement class IIIC, EN 574 P2HZ X3




Two-hand control unit for press controllers and safety circuits

Approvals

P2HZ X3	
	◆
	◆
	◆

Block diagram

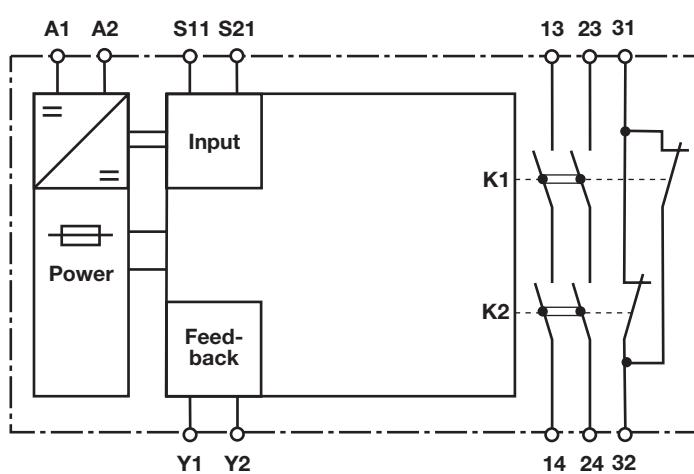

Unit features

- ▶ Positive-guided relay outputs:
 - 2 safety contacts (N/O), instantaneous
 - 1 auxiliary contact (N/C), instantaneous
- ▶ Connection options for:
 - 2 operator elements (buttons)
- ▶ LED indicator for:
 - Switch status channel 1/2
 - Supply voltage

Unit description

The two-hand control relay meets the requirements of EN 574 Type IIIC. It forces the operator to keep his hands outside the danger zone area during the hazardous movement. The unit is suitable for use on controllers for metalworking presses as a component for simultaneous switching.

It can be used in applications with

- ▶ Mechanical presses (EN 692)
- ▶ Hydraulic presses (EN 693)
- ▶ Safety circuits in accordance with EN 60204-1

Safety features

- The two-hand control relay meets the following safety requirements:
- ▶ The circuit is redundant with built-in self-monitoring
 - ▶ The safety function remains effective in the case of a component failure
 - ▶ The circuit prevents a further press stroke in the case of:
 - Relay failure
 - Contact welding
 - Coil defect on a relay
 - Open circuit
 - Short circuit

Requirement class IIIC, EN 574 P2HZ X3


Function description

- The two-hand control relay must be activated by simultaneously pressing

ing two buttons . If one or both of the buttons are released, the unit interrupts the control command for the hazardous movement.

- Reactivation: The output relays will not re-energise until both operator elements have been released and then re-operated simultaneously.

Timing diagram

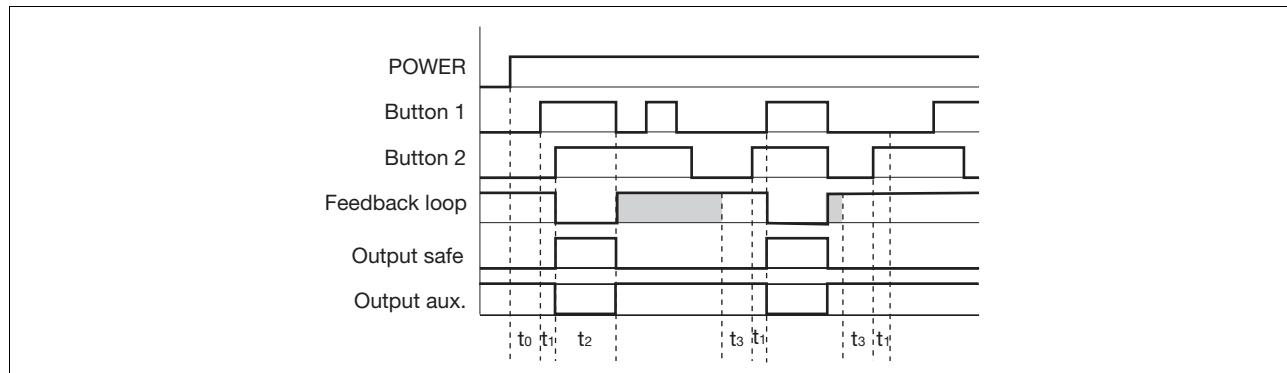

Key

- POWER: Supply voltage
- Button 1/Button 2: Input circuits S11, S21
- Feedback loop: Feedback loop Y1-Y2
- Output safe: Safety outputs 13-14, 23-24
- Output aux: Auxiliary contacts 31-32
- t_0 : Recovery time after power on
- t_1 : Simultaneity, channel 1 and 2
- t_2 : Operating cycle ended through button 1 or 2
- t_3 : Y1-Y2 must be closed before the button is operated (recovery time)
- Shaded area: Status irrelevant

Wiring

Please note:

- Information given in the "Technical details" must be followed.
- Outputs 13-14, 23-24 are safety contacts, output 31-32 is an auxiliary contact (e.g. for display).
- To prevent contact welding, a fuse should be connected before the output contacts (see technical details).
- Calculation of the max. cable runs I_{max} in the input circuit:

$$I_{max} = \frac{R_{lmax}}{R_l / km}$$

R_{lmax} = max. overall cable resistance (see technical details)
 R_l / km = cable resistance/km

- Use copper wire that can withstand 60/75 °C.
- Sufficient fuse protection must be provided on all output contacts with capacitive and inductive loads.

Requirement class IIIC, EN 574 P2HZ X3

Preparing for operation

- ▶ Supply voltage

Supply voltage	AC	DC

- ▶ Input circuit

Input circuit	Single-channel	Dual-channel
Two-hand button with detection of shorts across contacts		

- ▶ Feedback loop


Feedback loop	
Contacts from external contactors	

- ▶ Key

S1/S2 Two-hand button

Requirement class IIIC, EN 574 P2HZ X3

Terminal configuration

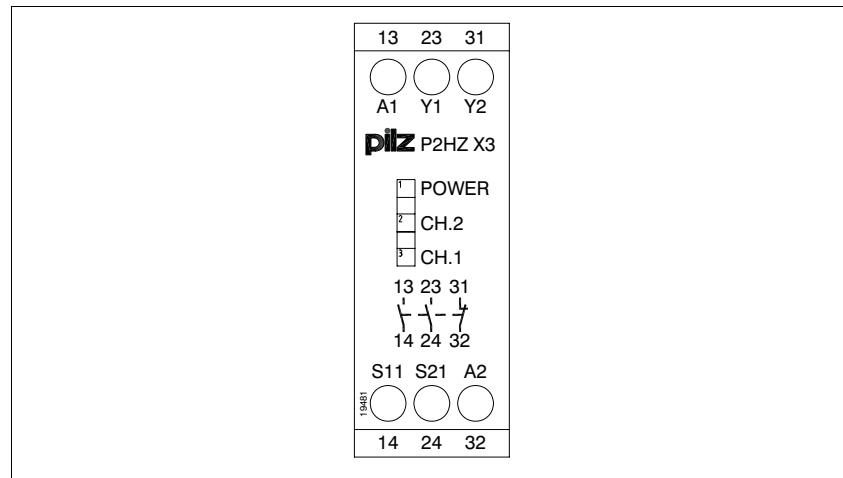


Installation

- ▶ The safety relay should be installed in a control cabinet with a protection type of at least IP54.
- ▶ Use the notch on the rear of the unit to attach it to a DIN rail.
- ▶ Ensure the unit is mounted securely on a vertical DIN rail (35 mm) by using a fixing element (e.g. retaining bracket or an end angle).

Notice

The distance of the button connected to the two-hand relay from the nearest danger zone must be large enough that if one of the buttons is released, the dangerous moment is interrupted before the operator can reach into the danger zone (see EN 999 "The positioning of protective equipment in respect of approach speeds of parts of the human body").

Dimensions

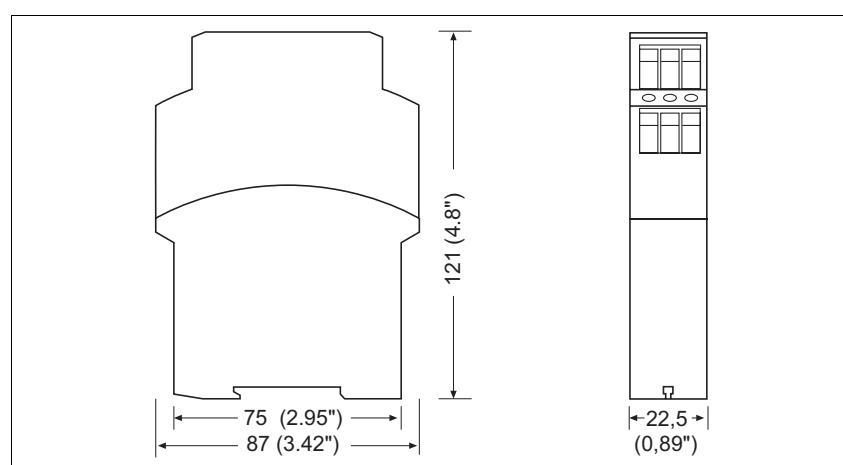


Two-hand control unit

Requirement class IIIC, EN 574 P2HZ X3

Notice

This data sheet is only intended for use during configuration. For installation and operation, please refer to the operating instructions supplied with the unit.

Service life graph

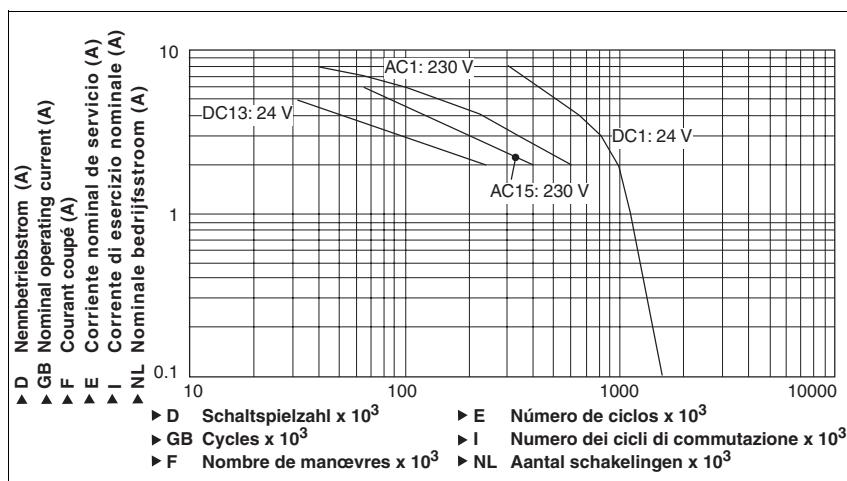

Technical details

Electrical data

Supply voltage U_B DC	24 V
Voltage tolerance	-15 % / 10 %
Power consumption at U_B DC	2.5 W
Residual ripple DC	10 %
Voltage and current at input circuit: 24 VDC	
N/O contact	15 mA
N/C contact	20 mA
feedback loop: 24 VDC	30.0 mA
Output contacts in accordance with EN 954-1 , Category 4	Safety contacts (N/O): 2 Auxiliary contacts (N/C): 1
Utilisation category in accordance with EN 60947-4-1	
Safety contacts	
AC1: 240 V	$I_{min}: 0.01 \text{ A}, I_{max}: 5.00 \text{ A}$ $P_{max}: 1250 \text{ VA}$
DC1: 24 V	$I_{min}: 0.01 \text{ A}, I_{max}: 5.00 \text{ A}$ $P_{max}: 125 \text{ W}$
Auxiliary contacts	
AC1: 240 V	$I_{min}: 0.01 \text{ A}, I_{max}: 2.5 \text{ A}$ $P_{max}: 600 \text{ VA}$
DC1: 24 V	$I_{min}: 0.01 \text{ A}, I_{max}: 2.5 \text{ A}$ $P_{max}: 60 \text{ W}$
Utilisation category in accordance with EN 60947-5-1	
AC15: 230 V	$I_{max}: 2.5 \text{ A}$
DC13 (6 cycles/min): 24 V	$I_{max}: 1.5 \text{ A}$
Contact material	AgSnO₂ + 0.2 μm Au
External contact fuse protection (EN 60947-5-1)	
Safety contacts	
Blow-out fuse, quick	6 A
Blow-out fuse, slow	4 A
Circuit breaker	4 A , 24 VAC/DC, characteristic B/C
Auxiliary contacts	
Blow-out fuse, quick	4 A
Blow-out fuse, slow	2 A
Circuit breaker	2 A , 24 VAC/DC, characteristic B/C
Max. overall cable resistance $R_{I_{max}}$ per input circuit	14 Ohm

Requirement class IIIC, EN 574 P2HZ X3

Times

Delay-on de-energisation
(reaction time in accordance with EN 574)

N/O contact	15 ms
N/C contact	30 ms
Recovery time	250 ms
Simultaneity, channel 1 and 2	Max. 500 ms

Environmental data

EMC	EN 60947-5-1, EN 61000-6-2
-----	-----------------------------------

Vibration in accordance with **EN 60068-2-6**

Frequency	10 - 55 Hz
Amplitude	0.35 mm
Climatic suitability	EN 60068-2-78
Airgap creepage	VDE 0110-1
Ambient temperature	-25 - 55 °C
Storage temperature	-25 - 85 °C

Protection type

Mounting (e.g. cabinet)	IP54
Housing	IP40
Terminals	IP20

Mechanical data

Housing material

Housing	PPO UL 94 V0
Front	ABS UL 94 V0

Cross section of external conductors with screw terminals

1 core flexible	0.20 – 4.00 mm²
2 core, same cross section, flexible: with crimp connectors, without insulating sleeve	0.20 – 2.50 mm²
without crimp connectors or with TWIN crimp connectors	0.20 – 2.50 mm²
Torque setting with screw terminals	0.60 Nm

Dimensions (H x W x D)

Weight

The standards current on **08/03** apply.

Order reference

Type	Features	Terminals	Order no.
P2HZ X3	24 VDC	Screw terminals	774 350